

ZX-066-040A 275X210mm

**For Service, Recharge, Repair, Retest
Please contact our distributor.**

MARINETYPE EXTINGUISHERS U.S. COAST GUARD MARINE APPROVAL IS ONLY VALID WHEN THE EXTINGUISHER IS EQUIPPED WITH AN APPROVED MARINETYPE BRACKET. SEE EXTINGUISHER LABEL UNDERWRITERS MANIFEST FOR APPROVED BRACKET DESIGNATION.

AFTER USE

Have your extinguisher recharged or replaced immediately even if only **partially** discharged. A momentary discharge could cause total loss of pressure. Take your extinguisher to a qualified fire extinguisher service agency for recharging, repairs, or retest. Look for "Fire Extinguishers" in the telephone directory.

Non refillable extinguishers should be discarded and a replacement should be obtained immediately for continued fire protection.

DO NOT DISPOSE OF USED EXTINGUISHER BY THROWING IN A FIRE. IT COULD EXPLODE CAUSING SERIOUS BODILY INJURIES.

DO NOT refill your extinguisher with any material other than that specified on the nameplate. The use of any other material could cause faulty performance or cause damage to the extinguisher causing it to rupture, resulting in bodily injuries.

Only parts recommended by manufacturer should be used for replacement in servicing your extinguisher.



VICTORY LIMITED WARRANTY

For six (6) years from date of purchase, Victory will repair or replace this product to the original owner free of charge, if defective in material or workmanship. This warranty does not apply to damage resulting from accident, alteration, abuse, or failure to follow instructions supplied.

Victory, as its option, may refund the purchase price in lieu of replacement or repair. **ANY AND ALL IMPLIED WARRANTIES, INCLUDING ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE SHALL BE LIMITED TO A PERIOD OF SIX (6) YEARS FROM DATE OF PURCHASE. VICTORY, ITS DEALERS AND DISTRIBUTORS SHALL NOT BE RESPONSIBLE OR IN ANY WAY LIABLE FOR ANY SPECIAL OR CONSEQUENTIAL DAMAGES FOR BREACH OF ANY WRITTEN OR IMPLIED WARRANTY.**

THIS WARRANTY GIVES YOU SPECIFIC LEGAL RIGHTS, AND YOU MAY ALSO HAVE OTHER RIGHTS WHICH MAY VARY STATE TO STATE.

Distributed by:

Victory Fire & Gas Inc.
2002 S Wentworth Ave Fl 2
Chicago, IL 60616 USA
www.victoryfiregas.com

Manual 001/15

Owner's Instruction Manual

FIRE CLASSIFICATION SYMBOLS



Common
Combustibles

If your extinguisher bears this symbol, it can be used on paper, cloth, wood, upholstery and other common combustibles.



Flammable
Liquids

If your extinguisher bears this symbol, it can be used on gasoline, oil, grease and other flammable liquids.



Electrical
Equipment

If your extinguisher bears this symbol, it can be used on live electrical equipment.

NOTICE:

BEFORE INSTALLING YOUR FIRE EXTINGUISHER, CAREFULLY READ THE FOLLOWING OPERATIONAL INSTRUCTION.


Be sure you understand the instructions so there will be no delay if a fire occurs. Before using your extinguisher, also read the operating instructions on the extinguisher label carefully. Be sure you understand the instructions in this manual and on the extinguisher label. Also be sure that those persons having access to this extinguisher are informed of its operation. The total discharge of extinguisher contents is a matter of seconds, therefore, any delay should be avoided.

OPERATION AND USE

In case of fire:

1. Call the fire department.
2. Get everyone out.
3. Plan your retreat.
4. The contents are discharged by pressure
-DO NOT DISCHARGE AT A PERSON'S FACE
-STAND A MINIMUM OF 6'-10' FROM THE FIRE.
5. Hold the extinguisher firmly in an upright position.
6. Stay low to avoid inhalation of smoke and aim discharge just under the flames. using a side to side motion, sweeping the entire width of the fire. For wall fires, start at the bottom, sweep from side to side, and progress upward. For floor fires, sweep from side to side and move forward as fire diminishes to reach far edge of fire.
7. **NEVER** move into area where fire was burning even though it appears to have been extinguished. You could be trapped and burned if the fire reflashs.
8. **NEVER** use water extinguishers on electrical fires.
9. **NEVER** use extinguishers at distances of less than 6-10 feet.

ALWAYS APPLY THE AGENT TO THE BASE OF THE FIRE AND WORK IT AWAY WITH A SWEEPING MOTION

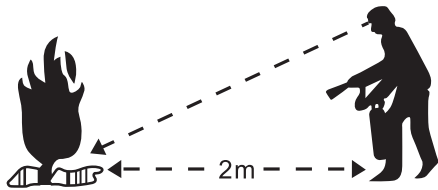

FIRE EXTINGUISHER AGENTS

| TYPE EXTINGUISHER | BASIC AGENT | MAY BE USED ON |
|-----------------------------------|--------------------|----------------------------|
| Multi- Purpose (ABC) Dry Chemical | Ammonium Phosphate | A B C |

INSPECTION & CARE


Be sure the extinguisher is in its proper location so there will be no delay in case of fire.

Your extinguisher should be checked once each month or more frequently if necessary to determine that:

1. The pointer on the pressure gauge is in the green operable area.
2. Hose or Nozzle are fit tight into extinguisher valve outlet and the nozzle opening has not been closed with some foreign object.
3. A ring pull is provided to prevent accidental discharge. This pin is secured by means of a plastic wire lockseal. On some models, the carry handle is sealed in place by a tape crossing over the lower portion. Check to make sure the lockseal is intact. A broken lockseal is an indication of tampering and that there may have been a partial or total loss of contents.
4. Weigh the extinguisher at least every six months; and if below the weight designated under 'Maintenance' on the extinguisher label, the extinguisher should be recharged.

CHECK:

- 1. GAUGE
- 2. NOZZLE
- 3. PULL PIN & SEAL
- 4. WEIGHT & CONDITION

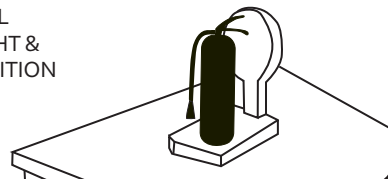

INSTALLATION

Extinguishers should be installed in accordance with the National Fire Protection Association standard, "Portable Fire Extinguishers," NFPA No. 10. Address - Batterymarch Park, Quincy, MA 02269

Check the extinguisher are in proper condition no damage from outside and fix the hose to the extinguisher valve outlet with hand tight.

Mount your extinguisher **upright** in a location that is easy to reach. Clean, dry locations near exits are recommended.

Be sure the mounting hardware (screws, rivets, etc.) is of the proper type and size to assure a positive mounting.

Your extinguisher should be mounted so the top is not more than 3 1/2 to 5 feet from the floor.

Do not locate in an area that will exceed 120°F temperature.

Use the mounting bracket furnished with the extinguisher or an approved. Victroy bracket if require. And fasten extinguisher to a solid surface.

